

# Silver Streak™

## (Product Data)

### Applications

- Flue Gas Desulfurization
- Limestone Slurry
- Ammonium Sulfate
- Gypsum Slurry

### Materials and Construction

All pipe manufactured by filament winding process using amine-cured epoxy thermosetting resin to impregnate strands of continuous glass filaments with a resin-rich corrosion barrier. Manufactured with a proprietary blend of abrasion-resistant additives, Silver Streak piping is offered with a standard 80 mil nominal liner.

Pipe is available in 2 in.-24 in. (50-600 mm) diameters with pressure ratings up to 225 psig (15.5 Bar) static at a maximum operating temperature of 225°F (107° C) and is ideal for yard piping. Silver Streak LD pipe, available in 30 in.-54 in. (9-16 m) diameters, is ideal for recirculating piping and operates at temperatures up to 200°F (93° C) and pressures up to 150 psig (10 Bar). Pipe diameters of 2 in.-6 in. (50-150 mm) are available in 20 ft (6 m) random lengths and the 8 in.-24 in. (200-600 mm) diameters are in 40 ft (13 m) random lengths.

The entire 80 mil nominal liner thickness contains 80% resin/abrasion-resistant additives and 20% reinforcement. The pipe is shipped spigot x spigot in 2 in.-12 in. (50-300 mm) sizes and spigot x spigot or bell x spigot in 14 in.-24v (350-600 mm) sizes.

ASTM D-2996 Classification: RTRP-11FX1-3110 for static design basis.


### Fittings

Fittings are manufactured with the same chemical/temperature capabilities as the pipe. Depending on the particular part and size, fittings will be compression molded, contact molded, hand fabricated or filament wound.

### Joining System

- **Bell & Spigot** - A matched-tapered joint secured with epoxy adhesive available from NOV Fiber Glass Systems.
- **Flanged** - Flanged connections are available for all components and diameters.

### View of Joint Illustrations



Bell & Spigot



Flanged

## Nominal Dimensional Data\*

Pipe Size		Inside Diameter		Outside Diameter		Minimum Reinforced Wall Thickness		Weight	
in.	mm	in.	mm	in.	mm	in.	mm	lbs/ft	kg/m
2	50	2.00	51	2.36	60	0.098	2.49	1.0	1.5
3	80	3.28	83	3.64	92	0.100	2.54	1.5	2.2
4	100	4.28	109	4.64	118	0.100	2.54	2.0	3.0
6	150	6.35	161	6.71	170	0.100	2.54	2.9	4.3
8	200	8.36	212	8.77	223	0.122	3.10	4.5	6.7
10	250	10.36	263	10.80	274	0.140	3.56	6.1	9.1
12	300	12.29	312	12.75	324	0.149	3.78	7.5	11.2
14	350	14.04	357	14.55	370	0.175	4.45	9.6	14.3
16	400	16.04	407	16.60	422	0.200	5.08	12.2	18.1
18	450	17.83	453	18.43	468	0.222	5.64	14.6	21.7
20	500	19.83	504	20.48	520	0.246	6.25	17.7	26.3
24	600	23.84	605	24.60	625	0.296	7.52	24.7	36.7

\*Liner thickness = 0.080 in./1.8 mm)

Tolerances or maximum/minimum limits can be obtained from NOV Fiber Glass Systems

## Supports

Proper pipe support spacing depends on the temperature and weight of the fluid in the pipe. The support spacing table is based on unrestrained continuous beam theory using the pipe bending modulus derived from long-term beam bending tests. The following tables were developed to ensure a design that limits beam mid-span deflection to ½ inch to ensure good appearance and adequate drainage. Any additional loads on the piping system such as insulation, wind, seismic, etc. requires further consideration. Restrained (anchored) piping systems operating at elevated temperatures may result in guide spacing requirements that are shorter than unrestrained piping systems. In this case, the maximum guide spacing governs the support span requirements for the system. Pipe spans near elbows require special attention. Both supported and unsupported elbows are considered in the following tables and must be followed to properly design the piping system.

There are seven basic guidelines to follow when designing an above ground piping system:

1. Do not exceed the recommended support span.
2. Support heavy valves and in-line equipment independently.
3. Protect pipe from external abrasion at supports.
4. Avoid point contact loads
5. Avoid excessive bending. This applies to handling, transporting, initial layout, and final installed position.
6. Avoid excessive vertical run loading. Vertical loads should be supported sufficiently to minimize bending stresses on pipe and fittings.
7. Provide adequate axial and lateral restraint to ensure line stability during rapid changes in flow (water hammer).

## Maximum Support Spacing for Uninsulated Pipe<sup>(1)</sup>

Size	Continuous Spans of Pipe <sup>(2)</sup>						
	in.	mm	feet			meters	
			75°F	200°F	24°C	93°C	
2	50	14.7	13.2	4.47	4.01		
3	80	17.0	15.2	5.18	4.64		
4	100	18.2	16.3	5.55	4.98		
6	150	20.3	17.5	6.17	5.35		
8	200	22.8	19.5	6.95	5.93		
10	250	24.9	20.9	7.59	6.38		
12	300	26.5	21.7	8.07	6.63		
14	350	28.5	23.5	8.68	7.17		
16	400	30.4	25.2	9.27	7.67		
18	450	32.1	26.5	9.78	8.09		
20	500	33.8	27.9	10.3	8.51		
24	600	37.1	33.2	11.3	10.1		

<sup>(1)</sup> For Sg=1.0, consult manufacturer for heavier insulated pipe support spans. Span recommendations include no provision for weight of (fittings, valves, etc.) or thrusts at branches and turns. Heavy valves and other appurtenances must be supported separately.

<sup>(2)</sup> Calculated spans are based on ½ in. mid-span deflections to ensure good appearance and adequate drainage. Total system stresses should always be taken into account by the system design engineer when determining support spans.

## Support Spacing vs. Specific Gravity


Specific Gravity	2.00	1.50	1.25	0.75
Multiplier	0.86	0.92	0.95	1.06

Example: 6 in. pipe @ 75°F (24°C) with a 1.5 specific gravity fluid, maximum support spacing = 21.1 x 0.92 = 19.4 ft.

## Adjustment Factors for Various Spans with Unsupported Fitting at Change in Direction


Span Type		Factor
Lc	Continuous interior or fixed end spans	1.00
C	Second span from supported end or unsupported fitting	0.80
A+B	Sum of unsupported spans at fitting	≤0.75*
D	Simple supported end span	0.67

\*For example: If continuous support is 10 ft. (3.04 m), A+B must not exceed 7.5 ft. (2.28 m) (A=3 ft. (0.91 m) and B=4.5 ft. (1.37 m)) would satisfy this condition.

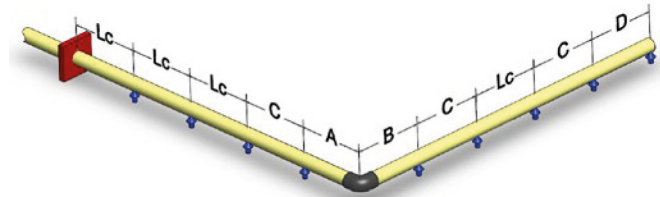

## Adjustment Factors for Various Spans with Supported Fitting at Change in Direction

Span Type		Factor
Lc	Continuous interior or fixed end spans	1.00
A	Second span from simple supported end or unsupported fitting	0.80
B	Simple supported end span	0.67

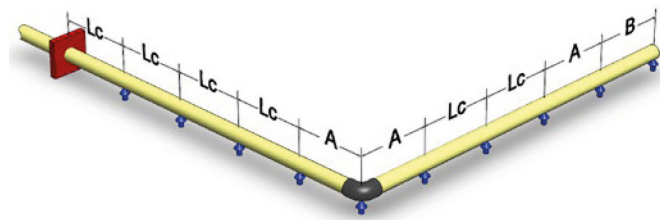

## Thermal Expansion

The effects of thermal gradients on piping systems may be significant and should be considered in every piping system stress analysis. Pipe line movements due to thermal expansion or contraction may cause high stresses or even buckle a pipe line if improperly restrained. Several piping system designs are used to manage thermal expansion and contraction in above ground piping systems. They are listed below according to economic preference:

1. Use of inherent flexibility in directional changes.
2. Restraining axial movements and guiding to prevent buckling.
3. Use expansion loops to absorb thermal movements.
4. Use mechanical expansion joints to absorb thermal movements.

To perform a thermal analysis the following information is required:

1. Isometric layout of piping system
2. Physical and material properties of pipe
3. Design temperatures
4. Installation temperature (Final tie in temperature)
5. Terminal equipment load limits
6. Support movements

A comprehensive review of temperature effects on fiberglass pipe may be found in NOV Fiber Glass Systems' Engineering and Piping Design Guide, Section 3.

Change in Temperature		Pipe Change in Length	
°F	°C	in./100 ft	cm/100 m
25	13.9	0.36	3.0
50	27.8	0.72	6.0
75	41.7	1.08	9.0
100	55.6	1.44	12.0

## Testing

Hydrostatic testing is recommended to evaluate the integrity of all new piping installations. For systems operating below the system rating, a test pressure of 1.5 times the system operating pressure is recommended; however, the maximum test pressure must not exceed 1.5 times the lowest pressure rated fiberglass component in the piping system.

The hydro test pressure should be repeated up to ten cycles from 0 psig to the test pressure to provide a high degree of confidence in the piping system. The final pressurization cycle should be allowed to stabilize for 15-30 minutes, then inspected for leaks. Do not attempt to repair leaks while system is pressurized. The hydro test should be repeated after any re-work is performed.

When hydro testing, open high-point vents (if used) to prevent entrapment of air in the lines as the system is slowly filled with water, then close the vents and slowly pressurize to the test pressure. Upon completion of hydro test, relieve the pressure on the system slowly, open vents and any drains to allow for complete drainage of the system.

## Water Hammer

Piping systems may be damaged by pressure surges due to water hammer. The use of soft start pumps and slow actuating valves will reduce the magnitude of surge pressures during operation and are highly recommended.

## Silver Streak - Product Data

### Typical Mechanical Properties

Pipe Property	70°F	21°C	150°F	65°C	200°C	93°C	Method	
	psi	MPa	psi	MPa	psi	MPa		
<b>Hydrostatic Design Basis</b>								
(LTHS)	23,400 <sup>(1)</sup>	161 <sup>(1)</sup>	23,400	161	17,500	121	ASTM D2992	
(LCL)	20,900 <sup>(1)</sup>	144 <sup>(1)</sup>	20,900	144	15,800	109	Proc. B (20 yrs)	
<b>Ultimate Hoop Stress at Weeping</b>	36,000	248	45,000	313	48,400	334	ASTM D1599	
<b>Circumferential</b>								
Hoop Tensile Modulus	3.84 x 10 <sup>6</sup>	26,500	2.86 x 10 <sup>6</sup>	19,700	2.25 x 10 <sup>6</sup>	15,500	NOV FGS	
Poisson's Ratio $\nu_{ha}$	0.61		0.73		0.8		NOV FGS	
<b>Longitudinal</b>								
Axial Tensile Strength	11,600	80	10,100	70	9,200	63.4	ASTM D2105	
Axial Modulus	2.24 x 10 <sup>6</sup>	15,000	1.53 x 10 <sup>6</sup>	11,200	1.24 x 10 <sup>6</sup>	8,550	ASTM D2105	
Poisson's Ratio $\nu_{ah}$	0.35		0.39		0.42		ASTM D2105	
Axial Bending Strength	23,000	85	-	-	-	-	NOV FGS	
Axial Bending Modulus	LTHS - 95% LCL	2.25 x 10 <sup>6</sup>	15,000	1.75 x 10 <sup>6</sup>	12,100	1.43 x 10 <sup>6</sup>	9,900	ASTM D2925
Shear Modulus	1.76 x 10 <sup>6</sup>	12,100	1.65 x 10 <sup>6</sup>	11,400	1.58 x 10 <sup>6</sup>	10,900	NOV FGS	

### Typical Physical Properties

Pipe Property	Value	Value	Method
<b>Thermal Conductivity Pipe wall</b>	0.19 BTU/hr•ft•°F	0.33 W/m°C	NOV FGS
<b>Thermal Expansion</b>	12.0 x 10 <sup>-6</sup> in/in/°F	21.6 x 10 <sup>-6</sup> mm/mm/°C	ASTM D696
<b>Flow Coefficient, Hazen Williams</b>	150		-
<b>Absolute Roughness</b>	1.7 x 10 <sup>6</sup> ft	5.3 x 10 <sup>6</sup> m	-
<b>Density</b>	121 lbs/ft <sup>3</sup>	1940 kg/m <sup>3</sup>	ASTM D792

<sup>(1)</sup> Value obtained at 150° F

<sup>(2)</sup> The differential pressure between internal and external pressure which causes collapse.

<sup>(3)</sup> A 0.67 design factor is recommended for short duration vacuum service. A full vacuum is equal to 14.7 psig (0.101 MPa) differential pressure at sea level.

<sup>(4)</sup> A 0.33 design factor is recommended for sustained (long-term) differential collapse pressure design and operation.

### Ultimate Collapse Pressure

Size		Collapse Pressure <sup>(2,3,4)</sup>			
		psig		MPa	
In.	mm	75°F	175°F	24°C	79°C
2	50	1900	1400	13.10	9.65
3	80	500	390	3.45	2.69
4	100	250	185	1.72	1.28
6	150	80	60	0.55	0.41
8	200	35	32	0.24	0.22
10	250	28	25	0.19	0.17
12	300	20	18	0.14	0.10
14	350	22	20	0.15	0.14
16	400	22	20	0.15	0.14
18	450	19	14	0.13	0.097
20	550	19	14	0.13	0.097
24	600	19	14	0.13	0.097

### Fiber Glass Systems

17115 San Pedro Avenue, Ste. 200, San Antonio, Texas 78232, USA

Phone: 210 477 7500 Fax: 210 477 7560

NOV Inc. has produced this brochure for general information only, and it is not intended for design purposes. Although every effort has been made to maintain the accuracy and reliability of its contents, NOV Inc. in no way assumes responsibility for liability for any loss, damage or injury resulting from the use of information and data herein nor is any warranty expressed or implied. Always cross-reference the bulletin date with the most current version listed at the web site noted in this literature.

August 2023, CI400ENG